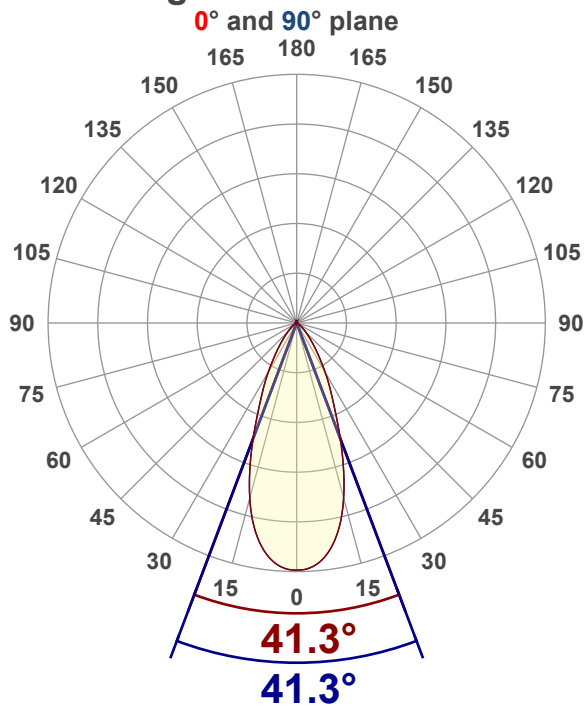


Light efficiency:**101 Lumen/Watt****Color temperature:****5087 K****Light quality:****CRI:92.7, R_g:89.5, R_f:100.0****P: 2 / V: - / F: 3****Output: 1203 lm****Peak: 1983 cd****Power: 11.9 W****Voltage: 120 V****Current: 0.102 A****PF: 0.97****THD: 18.64 %****Angular Distribution****Product name:****RA35-12F-90WH - 5000K****Test Date:****12/2/2025****Beam Angle (50% of the brightness of the centre):****41.3°****Field Angle (10% of the brightness of the centre):****77°****Cut Off Angle (2.5% of the brightness of the centre):****102.9°****Beam Details****measured at centre of beam*

Mounting Height (feet)\(meter)	Lux*	Footcandles*	Beam width (feet) / (meter)
4 ft / 1.2 m	1334 lx	124 fc	3 ft / 0.9 m
8 ft / 2.4 m	334 lx	31 fc	6 ft / 1.8 m
12 ft / 3.7 m	148 lx	14 fc	9 ft / 2.8 m
16 ft / 4.9 m	83 lx	8 fc	12.1 ft / 3.7 m
20 ft / 6.1 m	53 lx	5 fc	15.1 ft / 4.6 m


Beam center

Photometric Testing Report

Zonal Lumen Summary

Zone	Lumen	%Luminaire
0-30	897	74.56%
0-40	1076	89.44%
0-60	1185	98.50%
60-90	16.9	1.40%
70-100	4.98	0.41%
90-120	0.121	0.01%
0-90	1202	99.92%
90-180	0.508	0.04%
0-180	1203	100.00%

ISO Lux Diagram

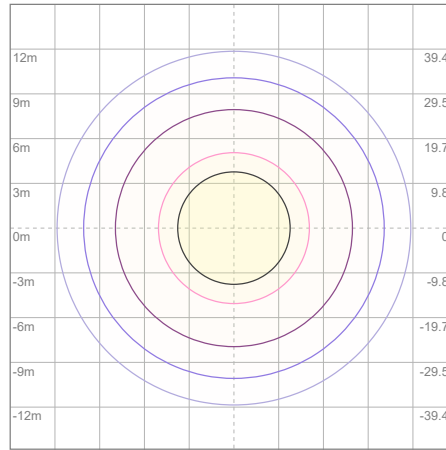

Lux at center:	213 lx
3%	6.39 lx
5%	10.65 lx
10%	21.30 lx
30%	63.90 lx
50%	106.50 lx

Conditions:
Number of planes: 8
Lux distribution on a surface when lamp is mounted at 3.05 meters from the surface.


Mounting height: 3.05 meters (10 feet)

Coefficients of Utilization

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio) Room Values are expressed as percentage of Lumens delivered to the task surface																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	108	106	111	109	107	105	105	103	101	101	100	98	98	96	95	94
2	108	103	99	96	106	102	98	95	98	95	93	95	93	91	93	91	89	87
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82
4	98	91	85	81	96	90	85	81	87	83	80	85	82	79	84	80	78	76
5	93	85	80	76	92	84	79	75	83	78	75	81	77	74	79	76	73	72
6	89	80	75	71	88	80	74	70	78	73	70	77	73	69	76	72	69	68
7	85	76	70	66	84	75	70	66	74	69	66	73	69	65	72	68	65	64
8	81	72	66	63	80	72	66	62	71	66	62	70	65	62	69	65	62	60
9	78	69	63	59	77	68	63	59	67	62	59	66	62	59	66	61	58	57
10	75	65	60	56	74	65	60	56	64	59	56	63	59	56	63	59	56	54

LAMPS (number of lamps)


Luminaire Budgetary Diagram

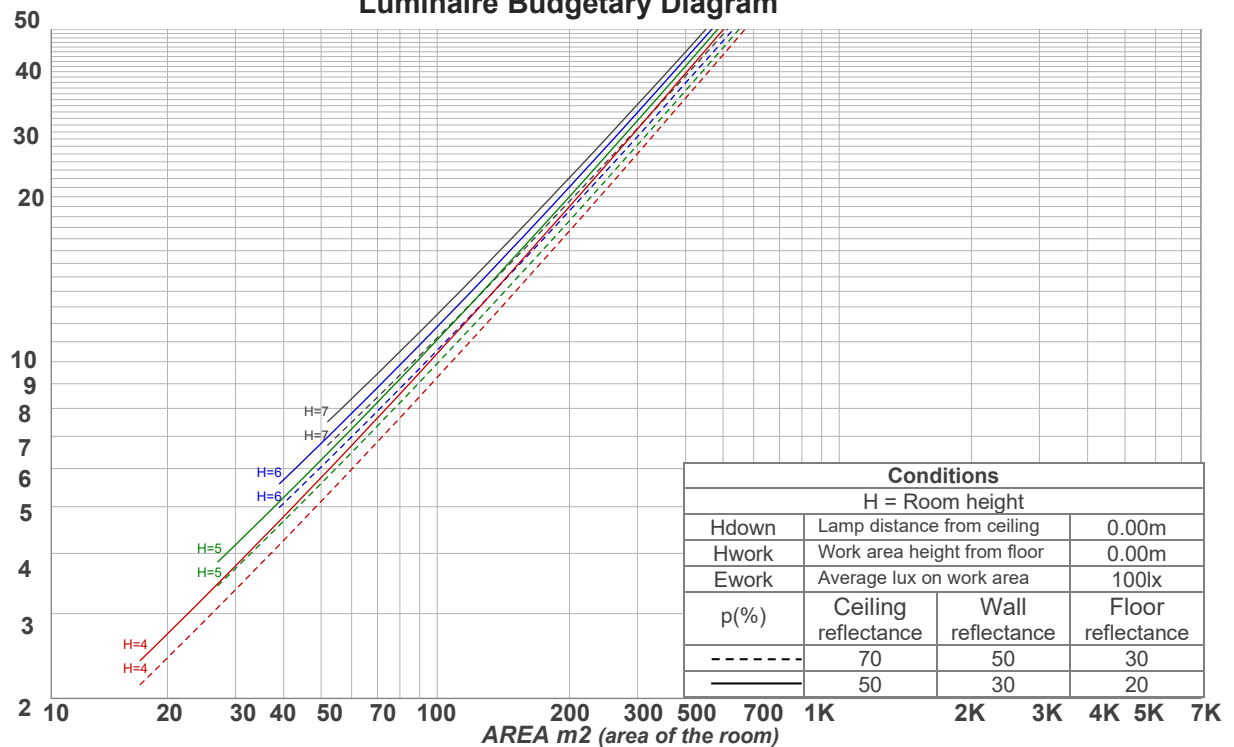





Conditions			
H = Room height			
Hdown	Lamp distance from ceiling	0.00m	
Hwork	Work area height from floor	0.00m	
Ework	Average lux on work area	100lx	
p(%)	Ceiling reflectance	Wall reflectance	Floor reflectance
-----	70	50	30
-----	50	30	20

ANSI/IES TM-30-18

P: 2 / V: - / F: 3

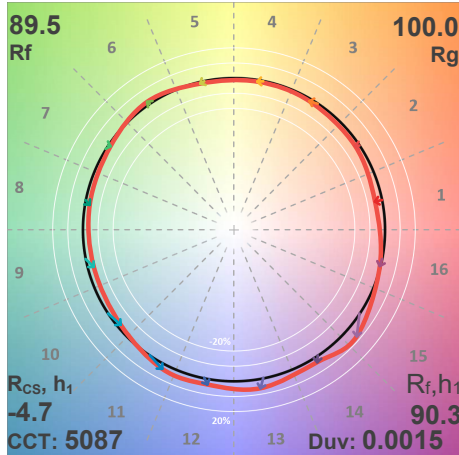

Hue Bin	R _f	Shifts (%)	
		Chroma	Hue
1	90	-5%	0%
2	94	-3%	1%
3	89	-2%	6%
4	91	-1%	4%
5	91	-1%	3%
6	95	2%	1%
7	96	-2%	0%
8	93	-3%	3%
9	90	-4%	6%
10	82	-3%	11%
11	80	3%	12%
12	92	4%	3%
13	90	6%	-3%
14	91	4%	-3%
15	82	7%	-13%
16	91	-1%	-5%

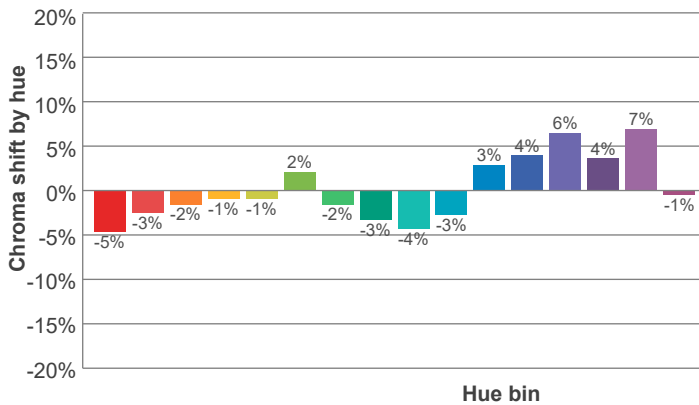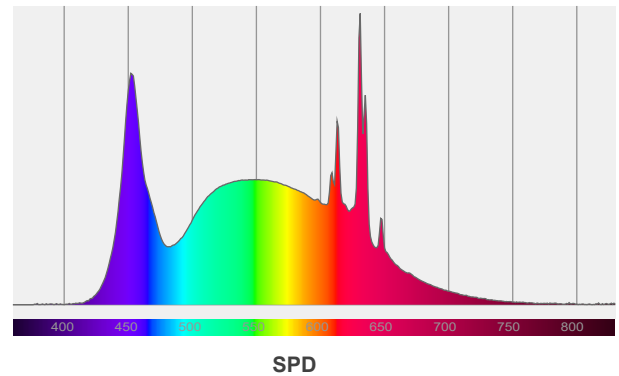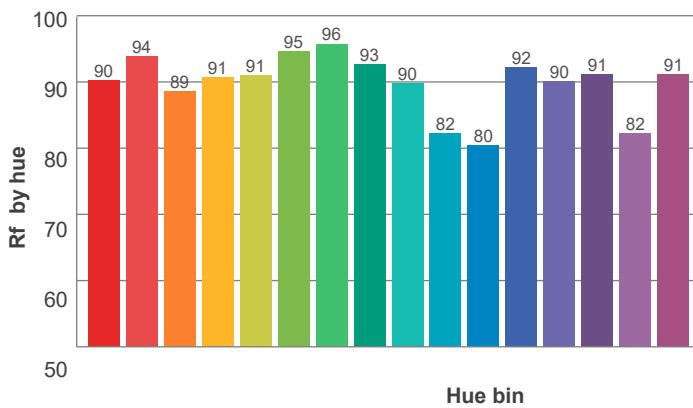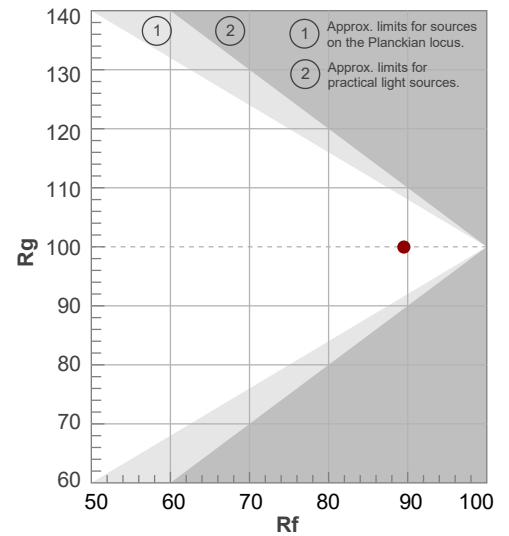


Red: 20.1%, Power=3.3mW

Blue: 18.9%, Power=13.2mW

Green: 32.7%, Power=17.8mW

UVA: 0%, Power=0.0mW

Dominant Wavelength: 580nm

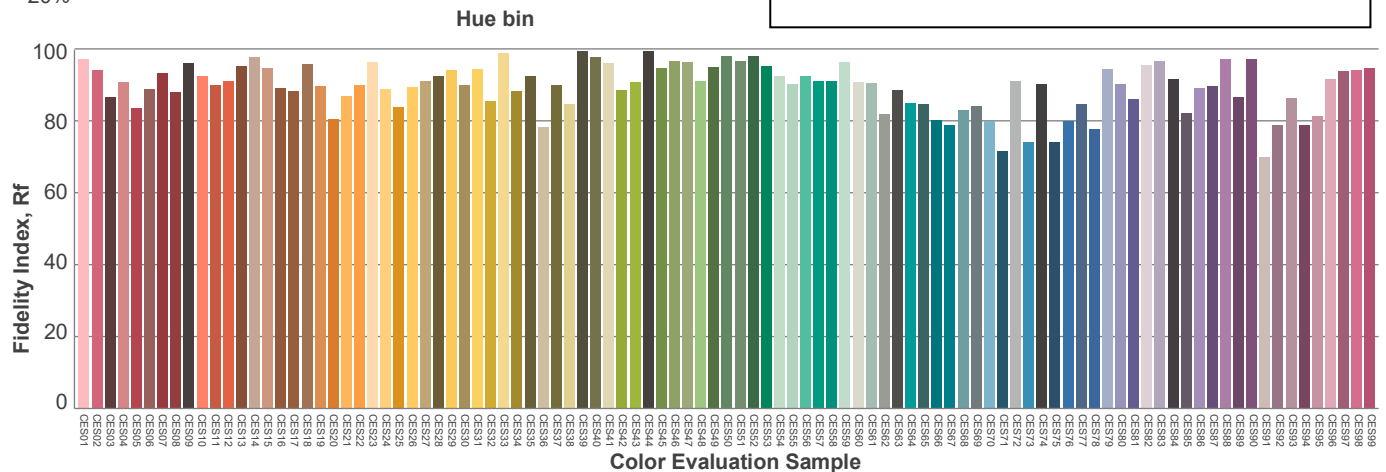1st Peak Wavelength: 631nm2nd Peak Wavelength: 452nm

Glare Evaluation According to UGR

p Ceiling		70	70	50	50	30	70	70	50	50	30
p Walls		50	30	50	30	30	50	30	50	30	30
p Floor		20	20	20	20	20	20	20	20	20	20
Room size X Y		Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis				
2H	2H	20.1	20.7	20.2	21.0	21.1	20.1	20.7	20.2	21.0	21.1
	3H	20.0	20.7	20.4	20.9	21.1	20.0	20.7	20.4	20.9	21.1
	4H	20.0	20.7	20.4	20.9	21.1	20.0	20.7	20.4	20.9	21.1
	6H	20.0	20.6	20.3	20.9	21.2	20.0	20.6	20.3	20.9	21.2
	8H	19.9	20.5	20.3	20.8	21.2	19.9	20.5	20.3	20.8	21.2
	12H	19.9	20.4	20.2	20.8	21.2	19.9	20.4	20.2	20.8	21.2
4H	2H	19.9	20.6	20.3	20.8	21.0	19.9	20.6	20.3	20.8	21.0
	3H	20.0	20.5	20.3	20.9	21.3	20.0	20.5	20.3	20.9	21.3
	4H	19.9	20.4	20.3	20.9	21.4	19.9	20.4	20.3	20.9	21.4
	6H	19.9	20.4	20.4	20.7	21.1	19.9	20.4	20.4	20.7	21.1
	8H	19.8	20.3	20.3	20.7	21.0	19.8	20.3	20.3	20.7	21.0
	12H	19.8	20.1	20.3	20.6	21.0	19.8	20.1	20.3	20.6	21.0
8H	4H	19.8	20.3	20.3	20.7	21.0	19.8	20.3	20.3	20.7	21.0
	6H	19.8	20.1	20.3	20.6	21.1	19.8	20.1	20.3	20.6	21.1
	8H	19.8	20.1	20.3	20.6	21.2	19.8	20.1	20.3	20.6	21.2
	12H	19.7	20.0	20.3	20.5	21.1	19.7	20.0	20.3	20.5	21.1
12H	4H	19.8	20.2	20.3	20.6	21.0	19.8	20.2	20.3	20.6	21.0
	6H	19.8	20.1	20.3	20.6	21.2	19.8	20.1	20.3	20.6	21.2
	8H	19.7	20.0	20.3	20.5	21.1	19.7	20.0	20.3	20.5	21.1
Variation of the observer position for the luminaire distance S											
S = 1.0H		3.2 / -4.2					3.2 / -4.2				
S = 1.5H		5.5 / -5.7					5.5 / -5.7				
S = 2.0H		7.3 / -6.5					7.3 / -6.5				
Standard table		n/a					n/a				
Correction summand		n/a					n/a				
Corrected glare indices referring to 1203 lm total luminous flux											