LITELINE CORPORATION | LITELINE.COM
T 416.996.1856 | 1.866.730.7704
F 905.709.5255 | 1.888.738.9736
Copyright © 2023, All rights reserved.


Photometric Testing Report

Light efficiency:
84 Lumen/Watt

Color temperature:
3091 K


Light quality:
CRI:93.4, R_g:102.8, R_f:91.6
R9: 73.3 / P: 2 / V: - / F: 2

Output:	**945 lm**
Peak:	**3998 cd**
Power:	**11.2 W**
Voltage:	**119 V**
Current:	**0.096 A**
PF:	**0.98**
THD:	**7.9 %**

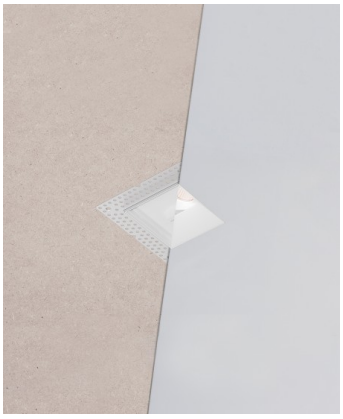

Angular Distribution

0° and 90° plane

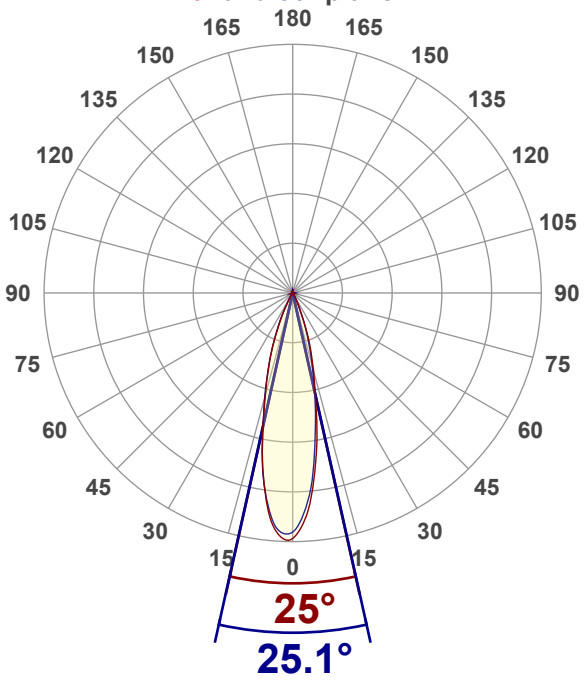

Product name:
S254XX-C30NC-TX-XX

Test Date:
8/26/2026


Beam Angle (50% of the brightness of the centre):
25.1°

Field Angle (10% of the brightness of the centre):
49.7°

Cut Off Angle (2.5% of the brightness of the centre):
60.9°

Beam Details

*measured at centre of beam

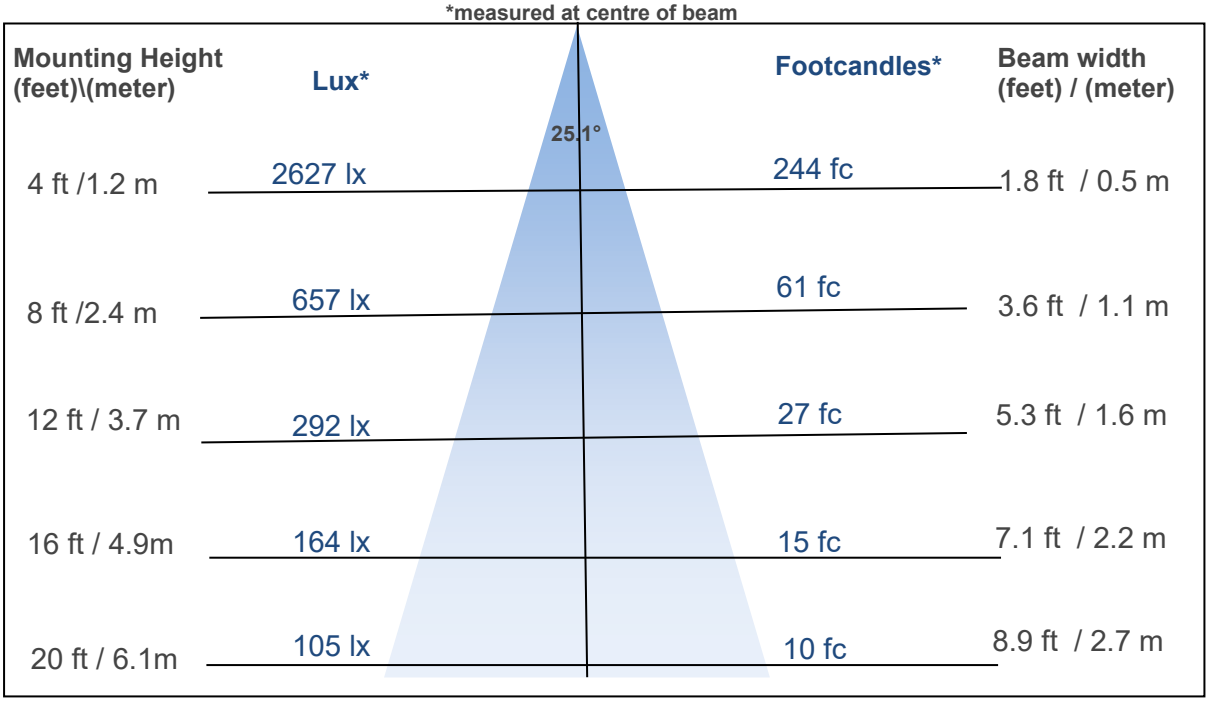

LITELINE CORPORATION | LITELINE.COM
T 416.996.1856 | 1.866.730.7704
F 905.709.5255 | 1.888.738.9736
Copyright © 2023, All rights reserved.


S254XX-C30NC-TX-XX

Photometric Testing Report

Zonal Lumen Summary

Zone	Lumen	%Luminaire
0-30	901	95.34%
0-40	925	97.88%
0-60	940	99.47%
60-90	3.35	0.35%
70-100	0.674	0.07%
90-120	0.182	0.02%
0-90	943	99.79%
90-180	1.46	0.15%
0-180	945	100.00%

ISO Lux Diagram

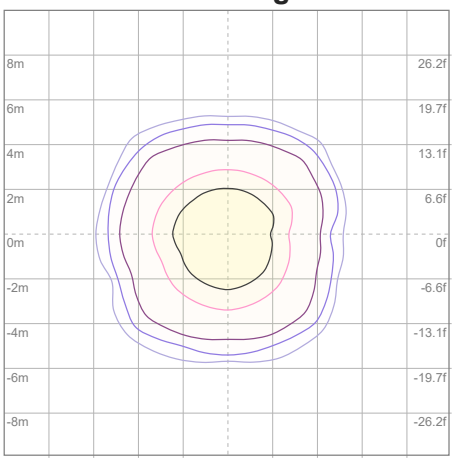

Mounting height: 3.05 meters (10 feet)

Lux at center:	420 lx
3%	12.60 lx
5%	21.00 lx
10%	42.00 lx
30%	126.00 lx
50%	210.00 lx


Conditions:
Number of planes: 8
Lux distribution on a surface when lamp is mounted at 3.05 meters from the surface.

Coefficients of Utilization

Ceiling reflectance	80				70				50			30			10			0
Wall reflectance	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
Floor reflectance	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	0
RCR	(RCR: Room Cavity Ratio)				Room Values are expressed as percentage of Lumens delivered to the task surface													
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	111	109	112	111	109	107	106	105	104	103	102	101	99	99	98	96
2	111	107	104	101	109	105	103	100	102	100	98	99	98	96	97	95	94	93
3	107	102	99	96	105	101	98	95	99	96	93	96	94	92	94	92	91	89
4	104	98	94	91	102	97	93	90	95	92	89	93	90	88	91	89	87	86
5	100	94	90	87	99	93	89	87	92	88	86	90	87	85	89	86	84	83
6	97	91	87	83	96	90	86	83	89	85	83	88	84	82	86	84	82	80
7	94	88	83	80	93	87	83	80	86	82	80	85	82	79	84	81	79	78
8	92	85	81	78	91	84	80	77	83	80	77	83	79	77	82	79	77	76
9	89	82	78	75	88	82	78	75	81	77	75	80	77	75	79	77	74	73
10	87	80	76	73	86	79	75	73	79	75	73	78	75	72	77	74	72	71

Luminaire Budgetary Diagram

LAMPS (number of lamps)

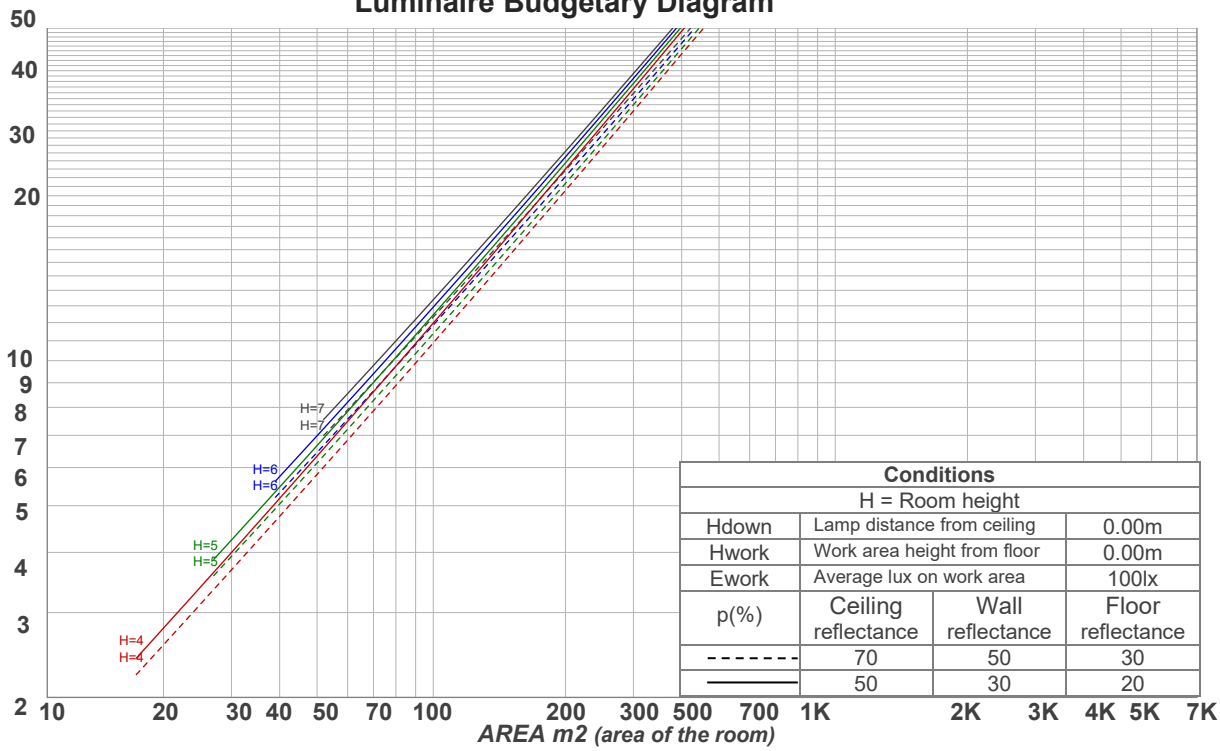

Conditions			
H = Room height			
Hdown	Lamp distance from ceiling		0.00m
Hwork	Work area height from floor		0.00m
Ework	Average lux on work area		100lx
p(%)	Ceiling reflectance	Wall reflectance	Floor reflectance
- - - - - - -	70	50	30
———	50	30	20

LITELINE CORPORATION | LITELINE.COM
T 416.996.1856 | 1.866.730.7704
F 905.709.5255 | 1.888.738.9736


Copyright © 2023, All rights reserved.

S254XX-C30NC-TX-XX


Liteline


Photometric Testing Report


ANSI/IES TM-30-18 P: **2** / V: **-** / F: **2**

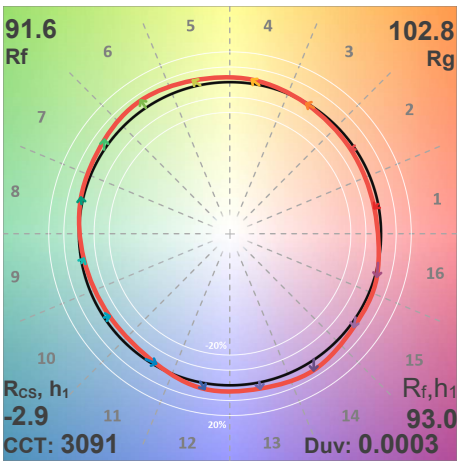


		Shifts (%)	
Hue Bin	R_f	Chroma	Hue
1	93	-3%	-2%
2	94	-3%	2%
3	89	0%	6%
4	90	3%	5%
5	92	4%	4%
6	91	6%	0%
7	90	3%	-5%
8	94	1%	-4%
9	95	-2%	-2%
10	93	-4%	1%
11	89	-1%	7%
12	91	4%	4%
13	93	5%	0%
14	91	6%	-4%
15	90	3%	-6%
16	89	1%	-9%

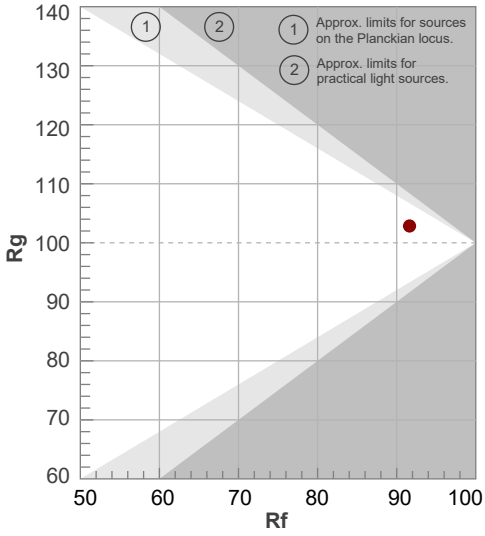

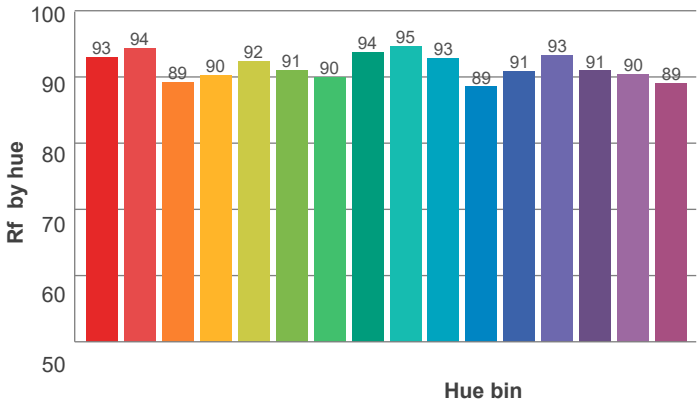

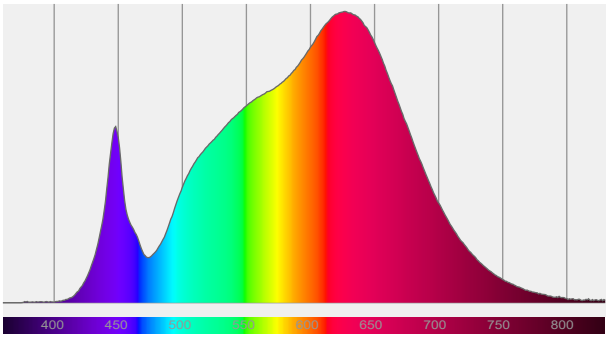

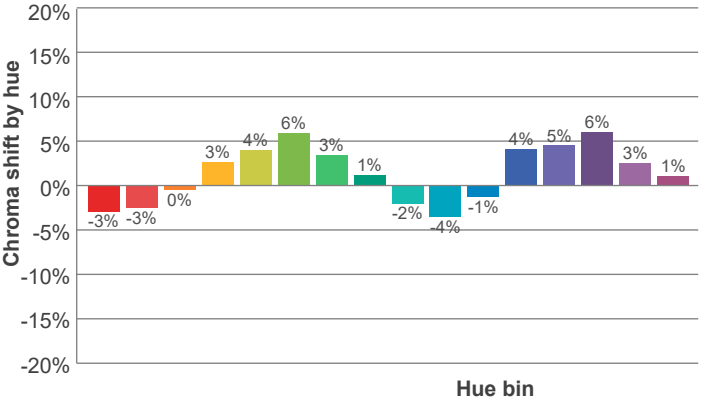

Red: 39.2%, Power=10.3mW

Blue: 6.6%, Power=3.1mW


Green: 24.9%, Power=11.9mW

UVA: 0%, Power=0.0mW

Dominant Wavelength:583nm

1st Peak Wavelength: 627nm

2nd Peak Wavelength:448nm

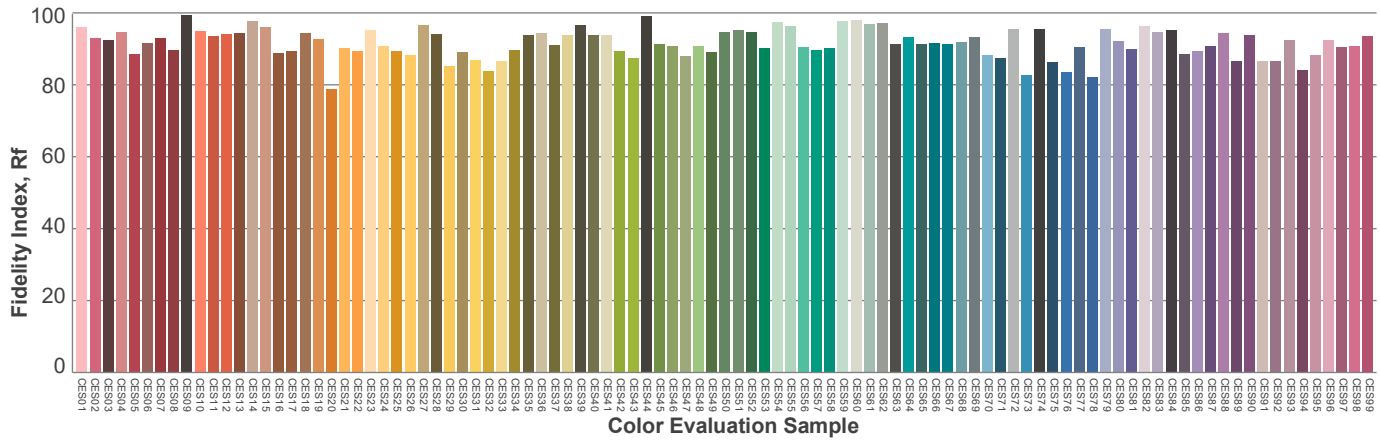

Copyright © 2023, All rights reserved.

Glare Evaluation According to UGR

Corrected, comprehensive UGR table according to 117-1995, S/H ratio=0.25

p Ceiling	70	70	50	50	30	70	70	50	50	30
p Walls	50	30	50	30	30	50	30	50	30	30
p Floor	20	20	20	20	20	20	20	20	20	20
Room size H = mouting height above eye level X Y	Viewing direction at right angles to lamp axis					Viewing direction parallel to lamp axis				
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a
Variation of the observer position for the luminaire distance S										
n/a	n/a					n/a				
n/a	n/a					n/a				
n/a	n/a					n/a				
Corrected glare indices referring to 945 lm total luminous flux										

UGR data could not be calculated due to missing/wrong symmetry. Go to Edit -> Photometric -> Corrections and select Correct asymmetry
UGR data could not be calculated due to missing/wrong symmetry. Go to Edit -> Photometric -> Corrections and select Correct asymmetry (UGR not defined for asymmetrical distributions).

Due to our continued efforts to improve our products, product specifications are subject to change without notice. Please refer to our website for the latest test results.